

DWG.NO 400201-00053

관리번호	MARK	DATE	DETAIL OF REVISION	CHECKED	APPROVED
	△				
	△				

Classification	In power supply OFF	Point of contact output classification	Rating load	Smallest point of contact voltage/electric current
NANOCON Alarm	OFF	Parameter setting Initial value – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm1	OFF	Parameter setting Initial value temperature warnning in a range – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm2	OFF	Parameter setting Initial value – FIL cleaning signature	AC250V/3A DC30V/3A	DC5V/10mA

Remote signal	OFF	ON	The part which is used for External start signal
Contact	Opening	Short or contact "Close"	Single pole and single action switch or make contact of start signal (Min. contact voltage/current satisfies more than 24V/20mA)

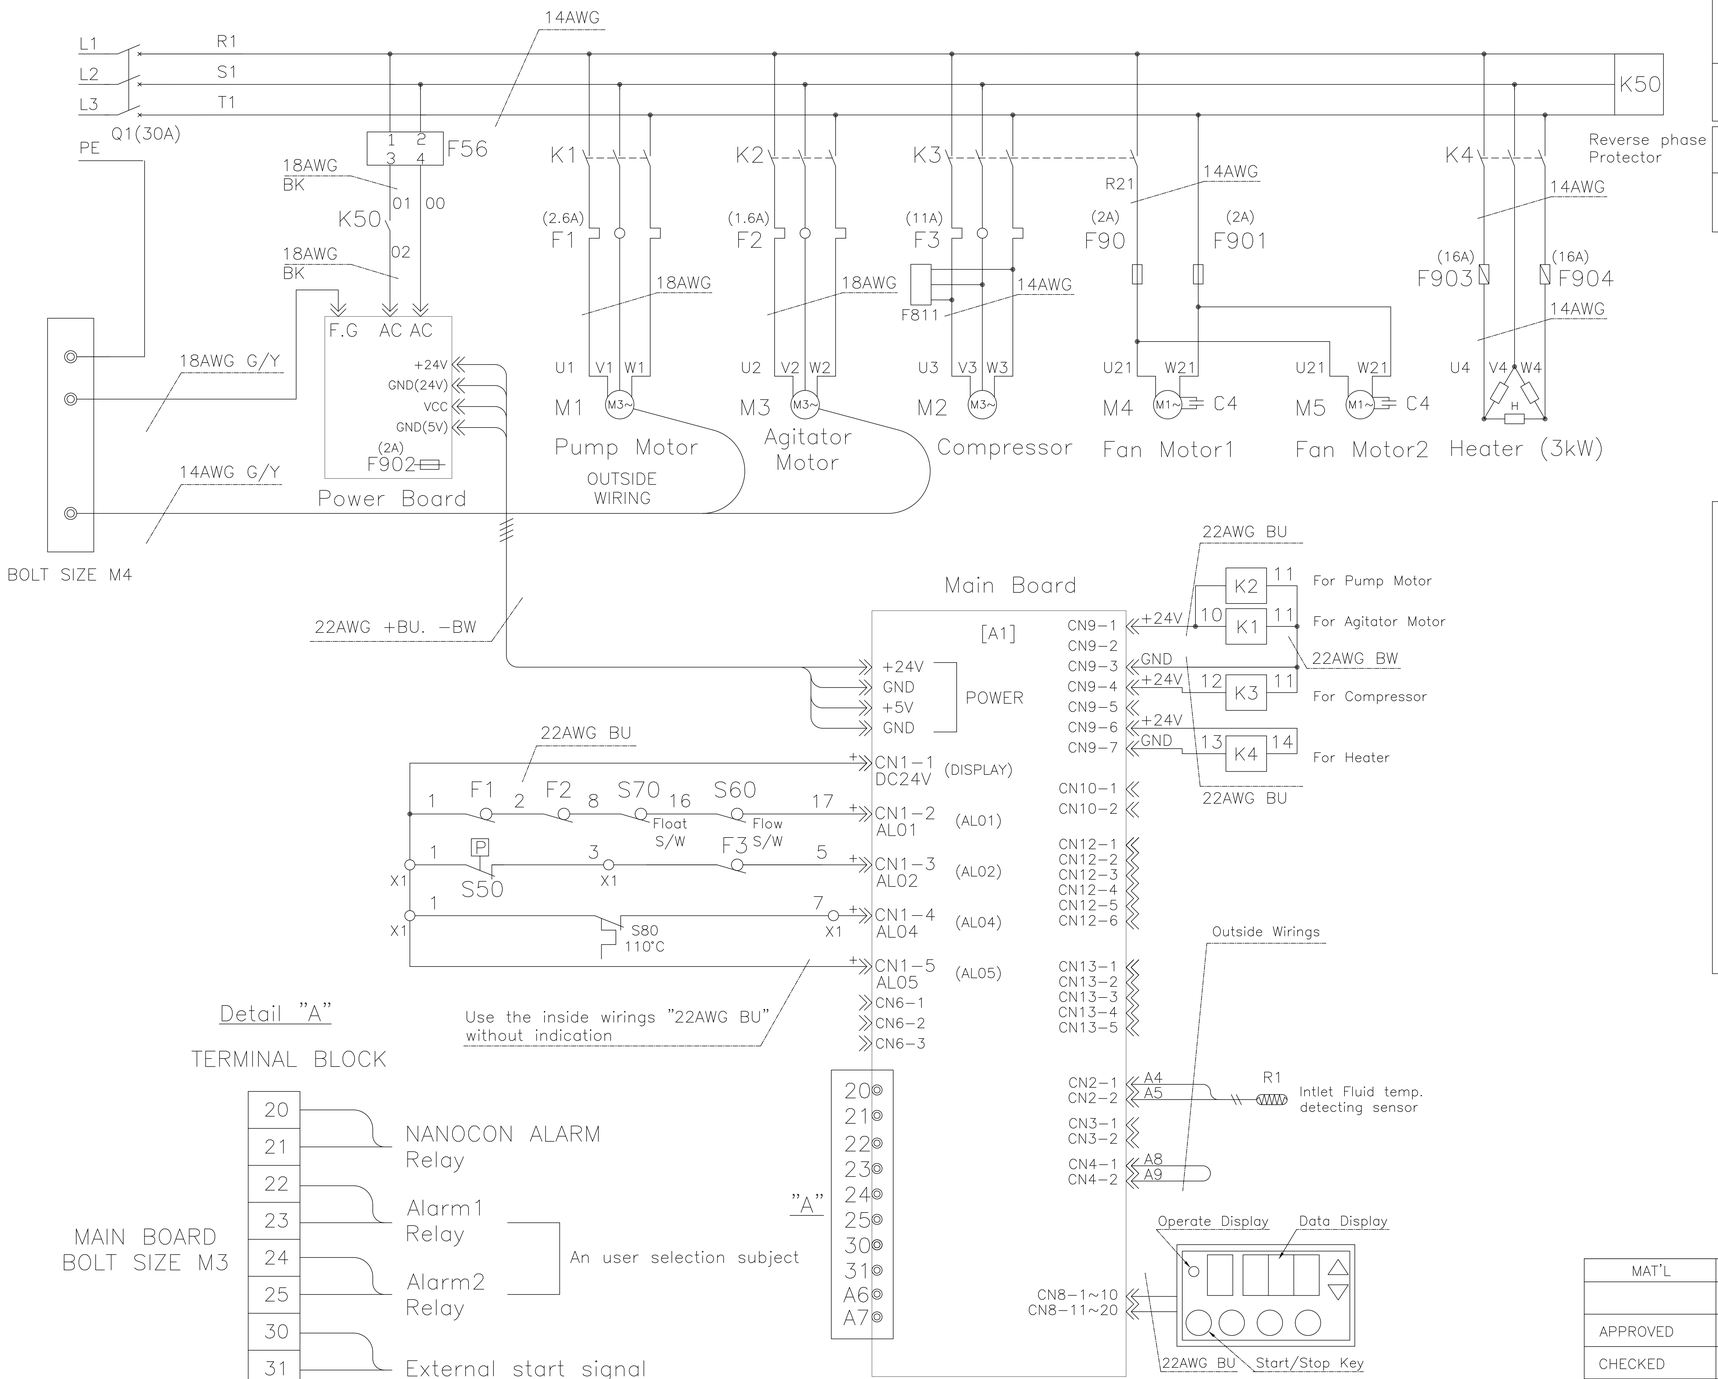

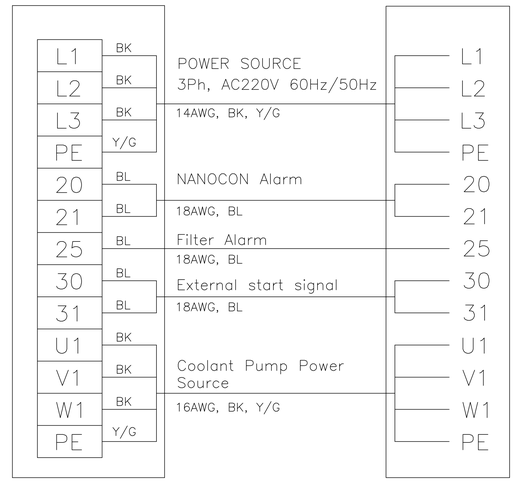

MAT'L	HEAT TREATMENT	SURF.TREATMENT		
			TITLE	ELECTRIC DIAGRAM
APPROVED	Tsunoda	2017.04.20		CIC6000E-CT
CHECKED	S.H.HA	2017.04.20	PJT NAME	COOLANT COOLER
DESIGNED	I.H.KIM	2017.04.20		NANOCON
DRAWN	I.H.KIM	2017.04.20	DRG NO.	400201-00053
SCALE N/S	W.T	Q'TY		
	MODEL CIC6000E-CT		KWANG RIM CORPORATION	

THIS DRAWING IS PROPRIETARY TO KWANG RIM
NO PART OF THIS DRAWING MAY BE REPRODUCED
WITHOUT THE PERMISSION OF KWANG RIM
이 도면의 무단복사 및 전용을 금함