

DWG.NO 400201-00055A-E1

관리번호	MARK	DATE	DETAIL OF REVISION	CHECKED	APPROVED
-A	⚠1 x 1	2019.03.21	F1 O.C.R설정 변경.	S.H.KIM	S.K.LEE
	△				

Classification	In power supply OFF	Point of contact output classification	Rating load	Smallest point of contact voltage/electric current
NANOCON Alarm	OFF	Parameter setting Initial value – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm1	OFF	Parameter setting Initial value temperature warnning in a range – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm2	OFF	Parameter setting Initial value – FIL cleaning signature	AC250V/3A DC30V/3A	DC5V/10mA

Remote signal	OFF	ON	The part which is used for External start signal
Contact	Opening	Short or contact "Close"	Single pole and single action switch or make contact of start signal (Min. contact voltage/current satisfies more than 24V/20mA)

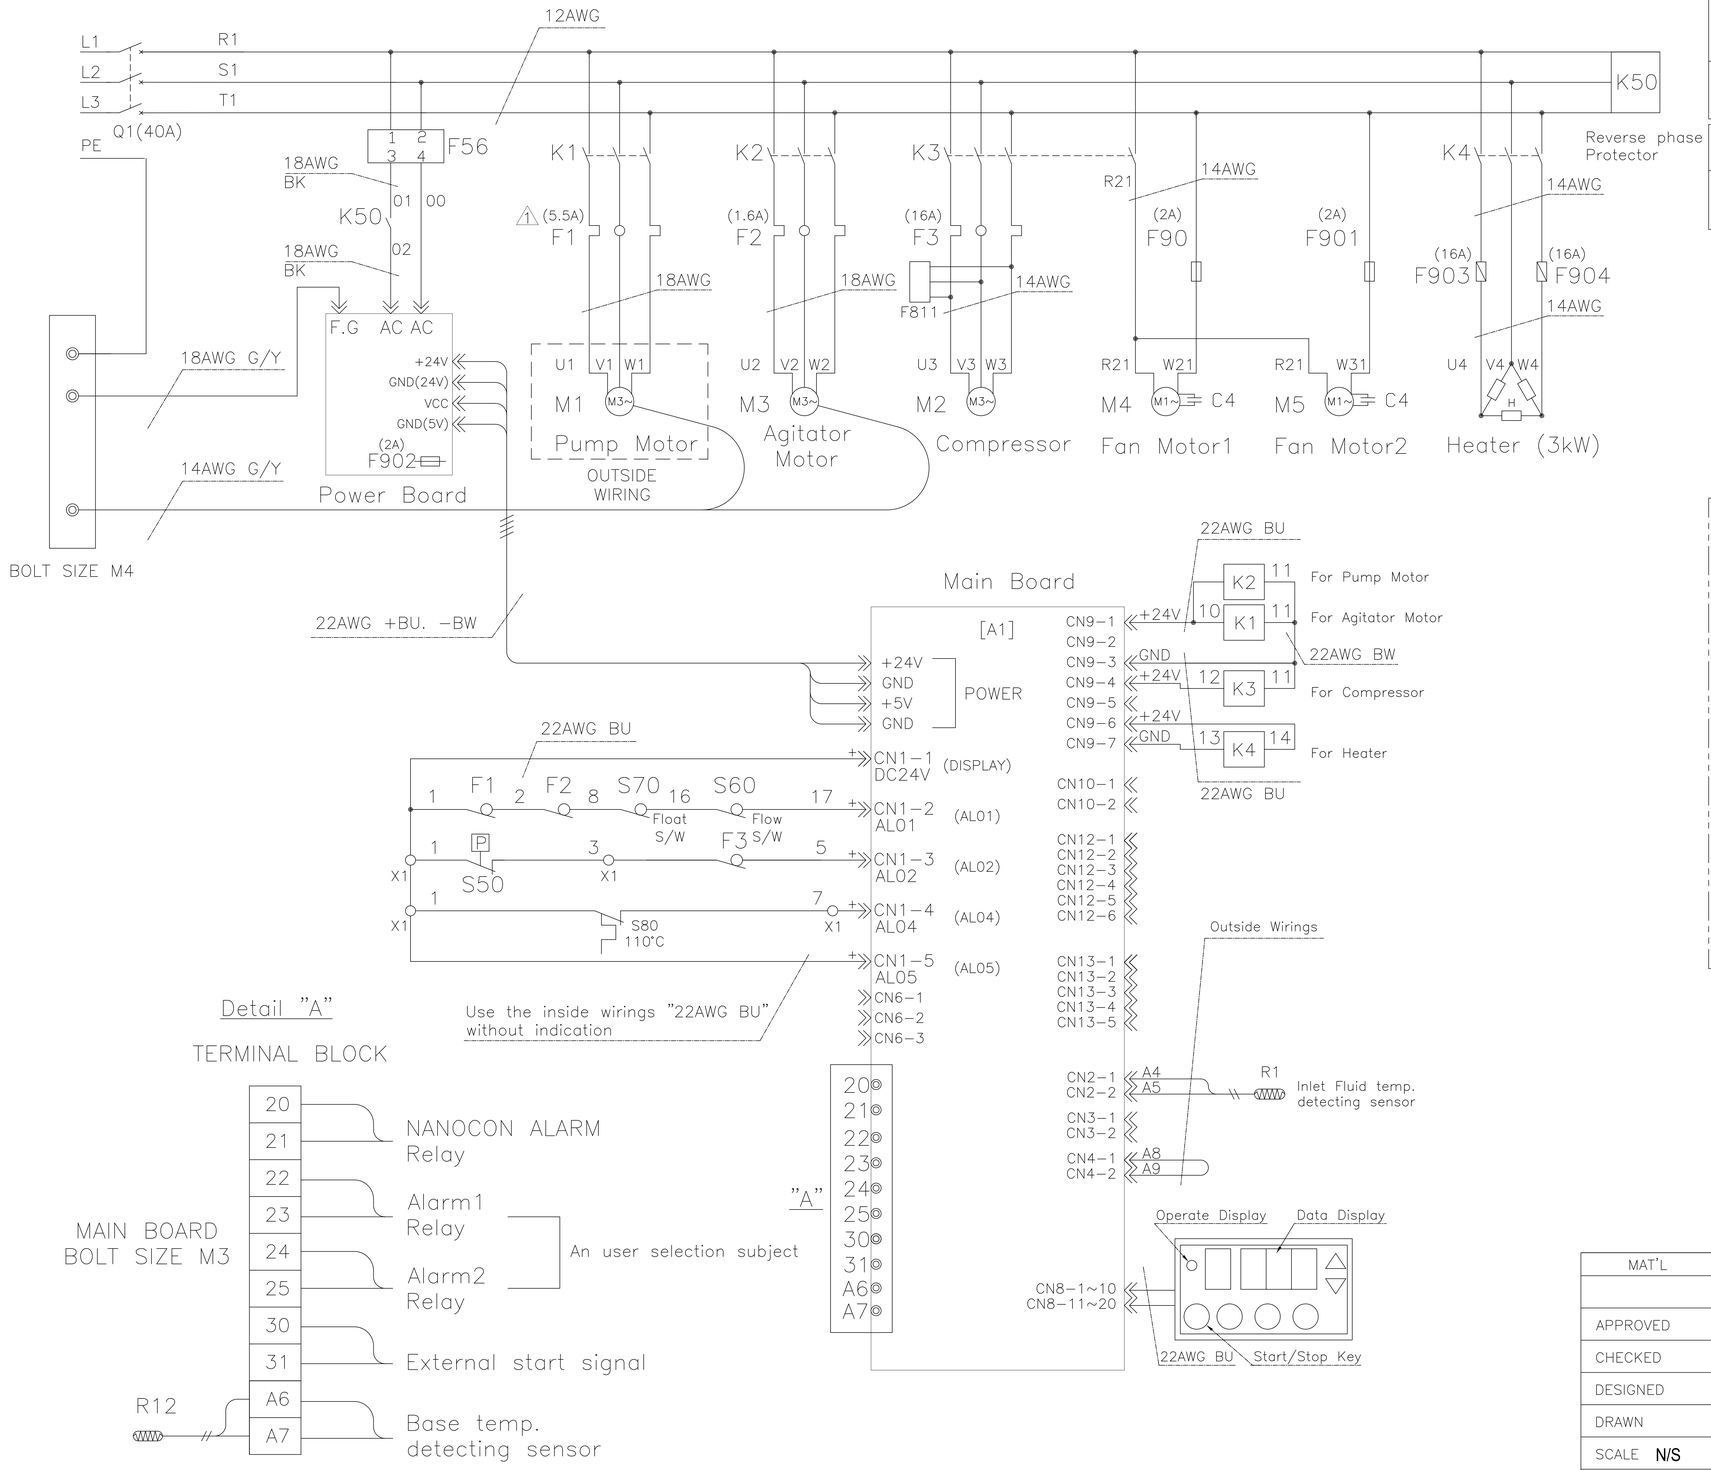

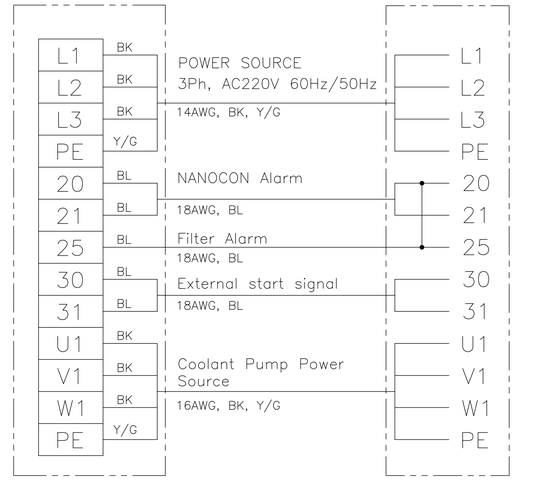

MAT'L	HEAT TREATMENT	SURF.TREATMENT	TITLE	ELECTRIC DIAGRAM
				CIC2201E-CT
APPROVED	TSUNODA	2017.09.01		
CHECKED	ISHIDA	2017.09.01	PJT NAME	COOLANT COOLER
DESIGNED	S.H.HA	2017.09.01		NANOCON
DRAWN	S.H.HA	2017.09.01	DRG NO.	400201-00055A-E1
SCALE N/S	W.T	Q'TY		
	MODEL CIC2201E-CT		KWANG RIM CORPORATION	

THIS DRAWING IS PROPRIETARY TO KWANG RIM.
NO PART OF THIS DRAWING MAY BE REPRODUCED
WITHOUT THE PERMISSION OF KWANG RIM.
㈜광림 무단복제 및 배포금지