
DWG.NO 400206-00305A

| 관리번호 | MARK | DATE | DETAIL OF REVISION | CHECKED | APPROVED |
|---|---|---|---|---|---|
| | △ | | | | |
| | △ | | | | |

| Classification | In power supply OFF | Point of contact output classification | Rating load | Smallest point of contact voltage/electric current |
|---|---|---|---|---|
| NANOCON Alarm | OFF | Parameter setting Initial value – Normally "Close" | AC250V/3A DC30V/3A | DC5V/10mA |
| Alarm1 | OFF | Parameter setting Initial value temperature warnning in a range – Normally "Close" | AC250V/3A DC30V/3A | DC5V/10mA |
| Alarm2 | OFF | Parameter setting Initial value – FIL cleaning signature | AC250V/3A DC30V/3A | DC5V/10mA |

| | | | |
|---|---|---|---|
| Remote signal | OFF | ON | The part which is used for External start signal |
| Contact | Opening | Short or contact "Close" | Single pole and single action switch or make contact of start signal (Min. contact voltage/current satisfies more than 24V/20mA) |


POWER SOURCE 200V 50/60Hz / 220V 60Hz 3Ph

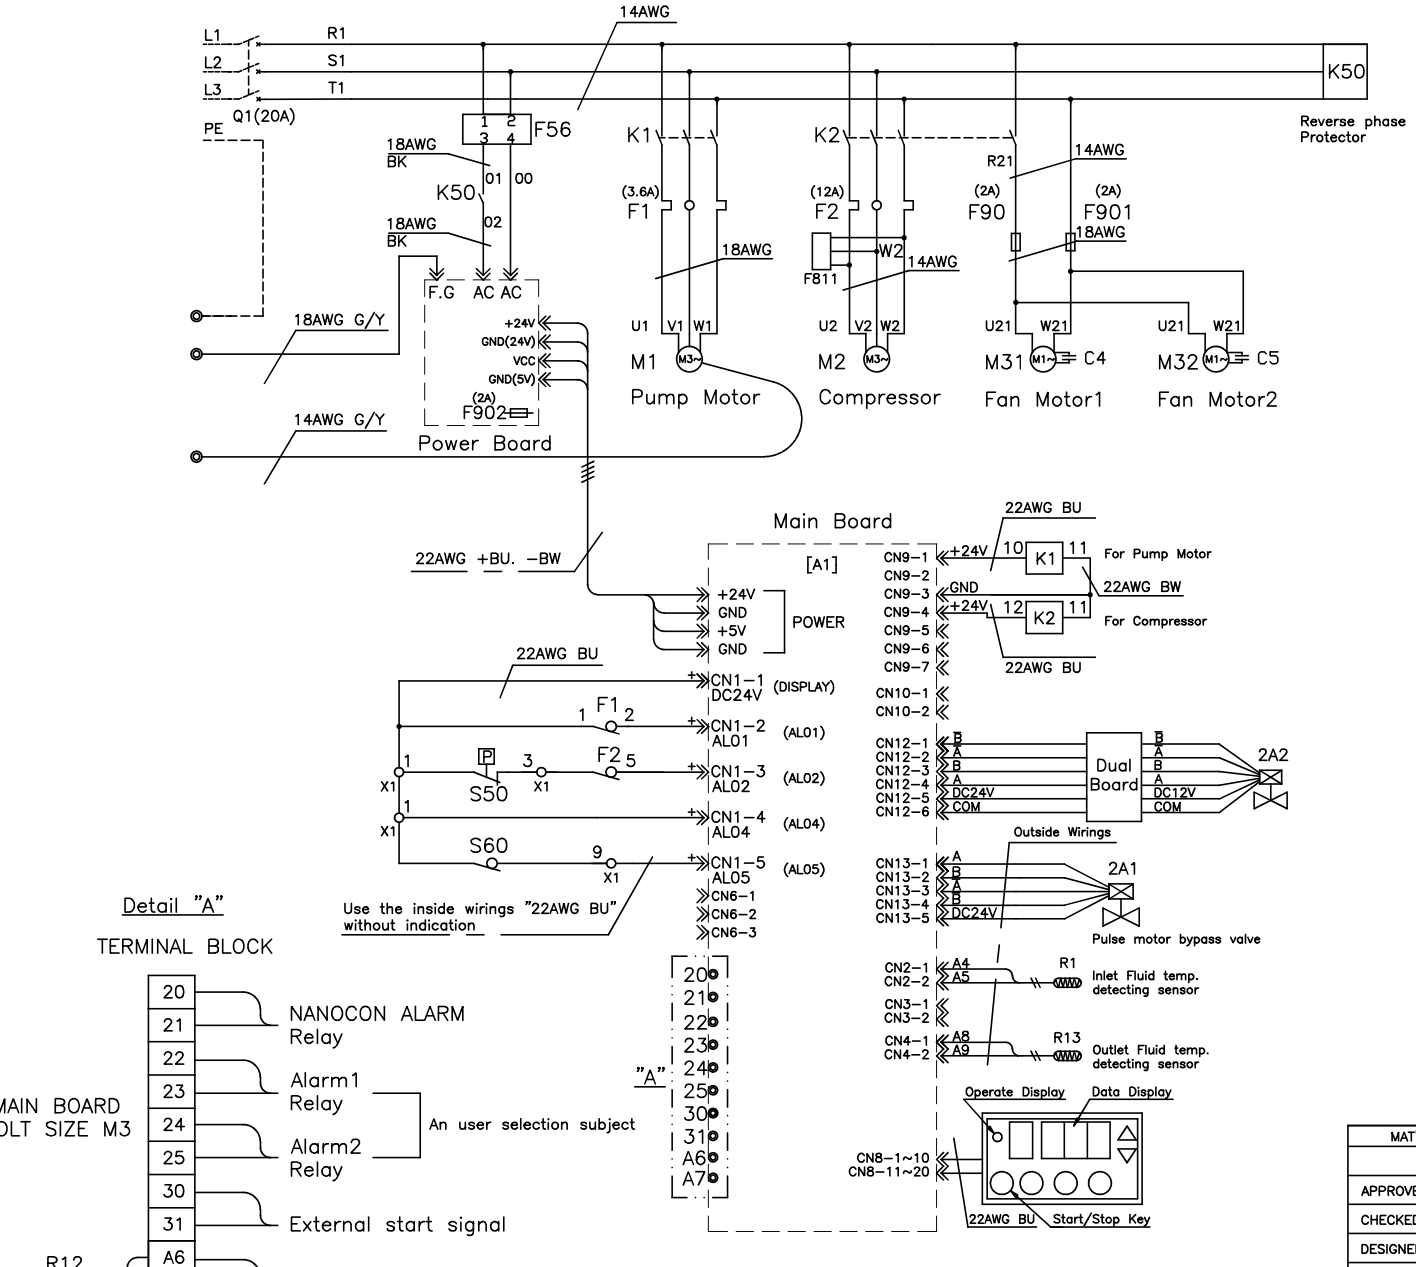


Detail "A"

TERMINAL BLOCK

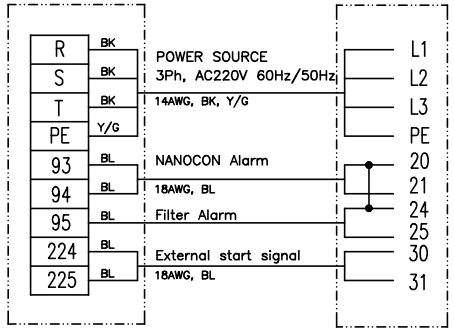


| MAT'L | HEAT TREATMENT | SURF.TREATMENT | | |
|---|---|---|---|---|
| | | | TITLE | ELECTRIC DIAGRAM |
| APPROVED | S.H.KIM | 2019.02.01 | | CIL1501A–CT |
| CHECKED | S.H.KIM | 2019.02.01 | PJT NAME | OIL COOLER |
| DESIGNED | KIM.S.H | 2019.02.01 | | NANOCON |
| DRAWN | KIM.S.H | 2019.02.01 | DRG NO. | 400206–00305A |
| SCALE N/S | W.T | Q'TY | | |
| | MODEL CIL1501A–CT | | KWANG RIM CORPORATION | |

THIS DRAWING IS PROPRIETARY TO KWANG RIM
WITHOUT THE PRIOR WRITTEN CONSENT OF KWANG RIM
NO PART OF THIS DRAWING MAY BE REPRODUCED