
DWG.NO 400202-00260B

관리번호	MARK	DATE	DETAIL OF REVISION	CHECKED	APPROVED
	△				
-A	1 X 2	2018.02.20	Pump변경 으로인한 N.F.B, O.C.R 사양변경	S.H.KIM	Tsunoda

Classification	In power supply OFF	Point of contact output classification	Rating load	Smallest point of contact voltage/electric current
NANOCON Alarm	OFF	Parameter setting Initial value – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm1	OFF	Parameter setting Initial value temperature warnning in a range – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm2	OFF	Parameter setting Initial value – FIL cleaning signature	AC250V/3A DC30V/3A	DC5V/10mA


Remote signal	OFF	ON	The part which is used for External start signal
Contact	Opening	Short or contact "Close"	Single pole and single action switch or make contact of start signal (Min. contact voltage/current satisfies more than 24V/20mA)

POWER SOURCE 200V 50/60Hz / 220V 60Hz 3Ph

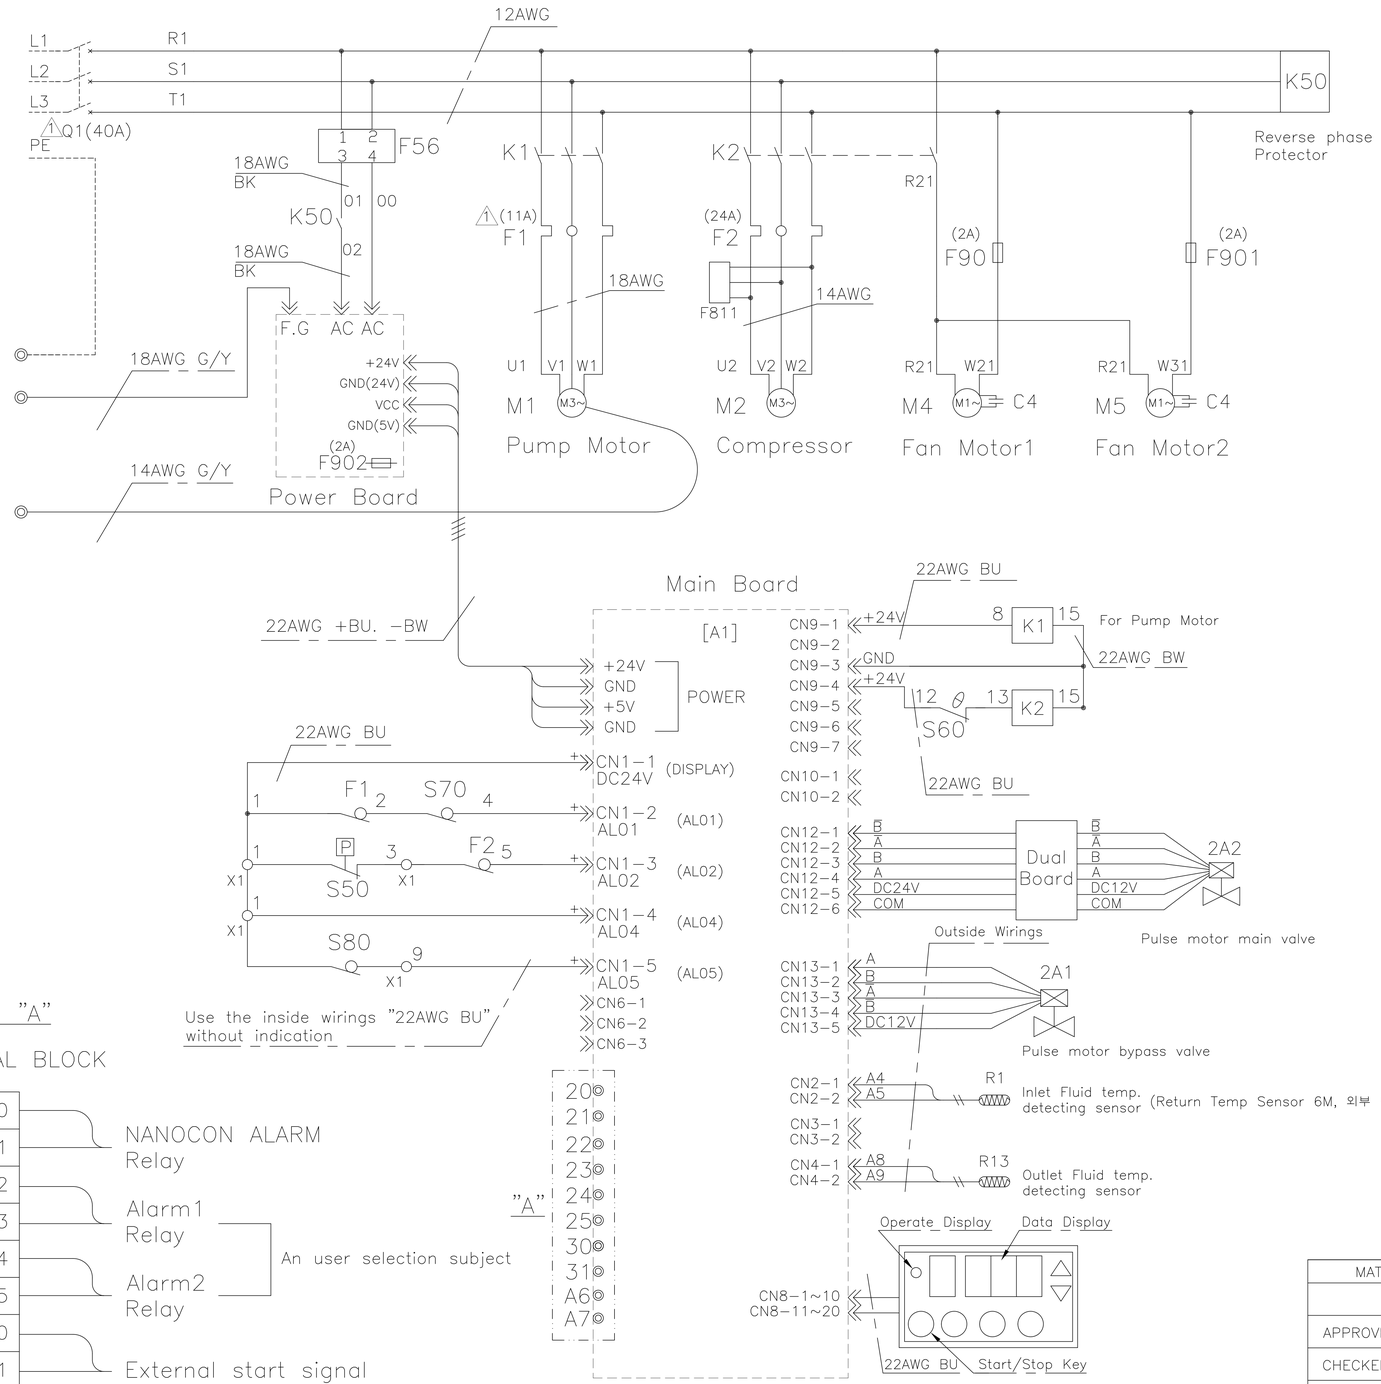

Detail "A"

TERMINAL BLOCK

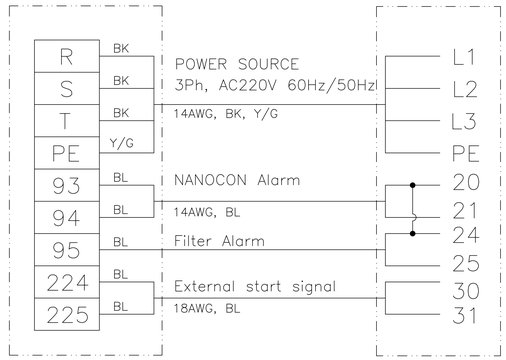

T-BOX

WATER COOLER

MAT'L	HEAT TREATMENT	SURF.TREATMENT	TITLE	ELECTRIC DIAGRAM
				CIW2201A-CT
APPROVED	S.H.KIM	2019.01.22		
CHECKED	S.H.KIM	2019.01.22	PJT NAME	WATER COOLER
DESIGNED	KIM.S.H	2019.01.22		NANOCON
DRAWN	KIM.S.H	2019.01.22	DRG NO.	400202-00260B
SCALE N/S	W.T	Q'TY		KWANG RIM
	MODEL CIW2201A-CT			KWANG RIM CORPORATION

THIS DRAWING IS PROPRIETARY TO KWANG RIM.
NO PART OF THIS DRAWING MAY BE REPRODUCED
WITHOUT THE PERMISSION OF KWANG RIM
이 도면은 광림의 소유로 무단 복제 및 배포를 금합니다