
DWG.NO 400206-00335


관리번호	MARK	DATE	DETAIL OF REVISION	CHECKED	APPROVED
	△				
	△				

Classification	In power supply OFF	Point of contact output classification	Rating load	Smallest point of contact voltage/electric current
NANOCON Alarm	OFF	Parameter setting Initial value – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm1	OFF	Parameter setting Initial value temperature warnning in a range – Normally "Close"	AC250V/3A DC30V/3A	DC5V/10mA
Alarm2	OFF	Parameter setting Initial value – FIL cleaning signature	AC250V/3A DC30V/3A	DC5V/10mA

Remote signal	OFF	ON	The part which is used for External start signal
Contact	Opening	Short or contact "Close"	Single pole and single action switch or make contact of start signal (Min. contact voltage/current satisfies more than 24V/20mA)


POWER SOURCE 200V 50/60Hz 3Ph
220V 60Hz

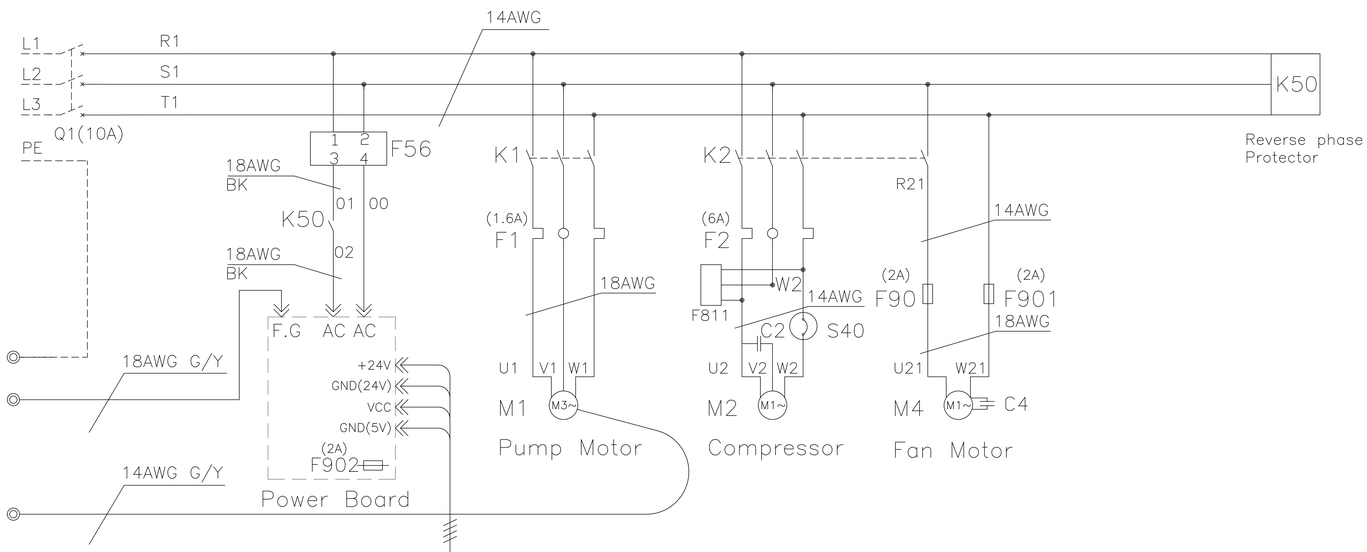


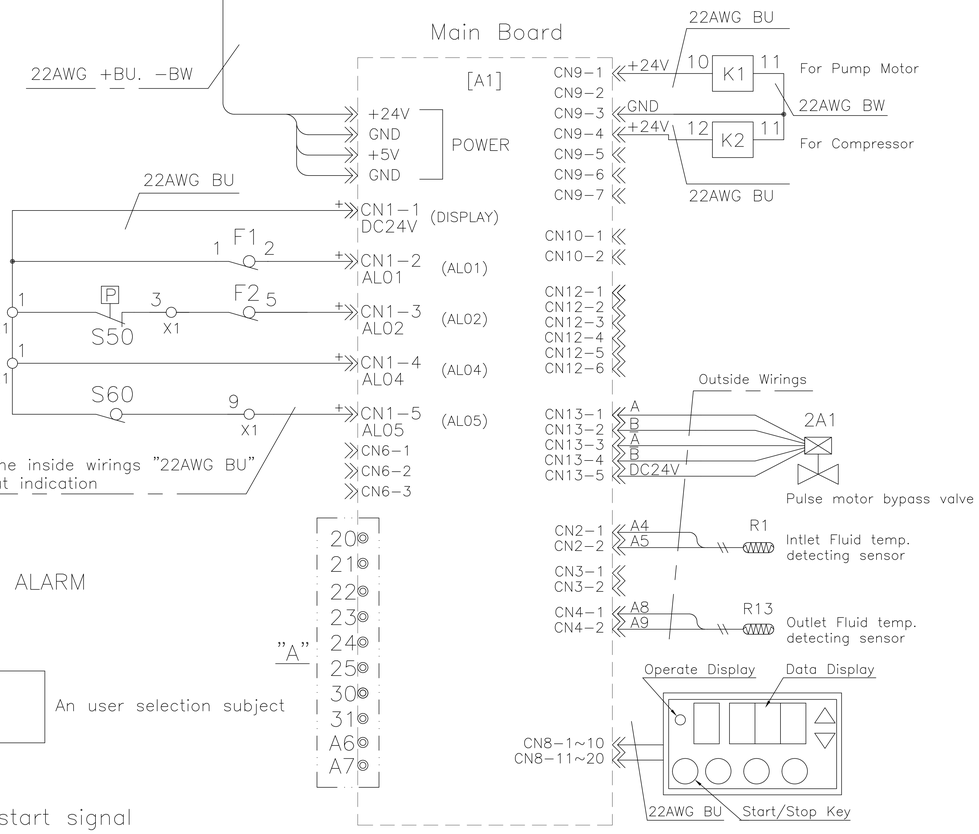

Detail "A"

TERMINAL BLOCK

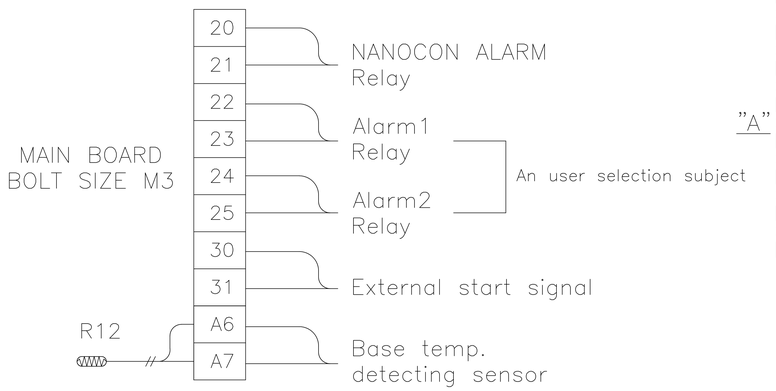

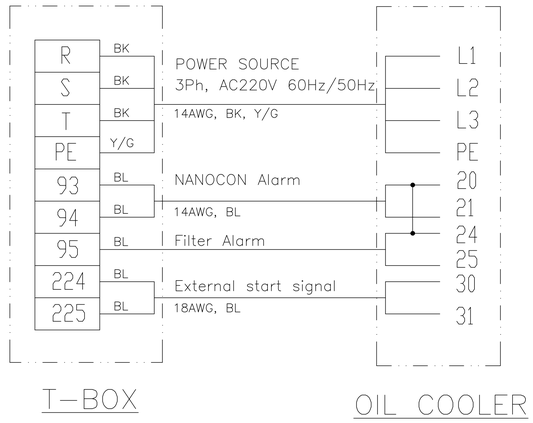

MAT'L	HEAT TREATMENT	SURF.TREATMENT	TITLE	ELECTRIC DIAGRAM
				CIL501A-CT
APPROVED				
CHECKED			PJT NAME	OIL COOLER
DESIGNED	S.H.HA	2012.01.03		NANOCON
DRAWN	S.H.HA	2012.01.03	DRG NO.	400206-00335
SCALE N/S	W.T	Q'TY		
	MODEL CIL501A-CT		KWANG RIM CORPORATION	

THIS DRAWING IS PROPRIETARY TO SHC
NO PART OF THIS DRAWING MAY BE REPRODUCED
WITHOUT THE PERMISSION OF SHC.